

FEATURES & SPECIFICATIONS

INTENDED USE — Ideal one-for-one replacement of conventional lighting systems such as HID and fluorescent. For use in light Industrial applications such as, warehousing and other large indoor spaces with mounting heights ranging from 10' - permitted. Certain airborne contaminants can diminish integrity of acrylic and LED's. Click here for Acrylic Environmental Compatibility table for suitable uses.

Certain airborne contaminants may adversely affect the functioning of LEDs and other electronic components, depending on various factors such as concentrations of the contaminants, ventilation, and temperature at the end-user location. Click here for a list of substances that may not be suitable for interaction with LEDs and other electronic components.

 $\textbf{CONSTRUCTION} \ -\! \text{ Extruded aluminum channels enable superior thermal performance. Glare Control}$ acrylic lens diffuses light source and reduces glare while protecting LEDs. Lens meets DLC 5.1 standards for UGR (Unified Glare Rating).

ELECTRICAL — 70% lumen maintenance at > 100,000 hours. Thermally protected driver standard with 0-10V dimming. Luminaire surge protection level: designed to withstand up to 6kV/3kA per ANSI C82.77-5-2015 Multi-volt driver, 120-277V standard.

INSTALLATION — Fixture is suitable for mounting by chain, cable, surface-mount bracket, pendant monopoint, or hook monopoint. Utilizing appropriate mounting accessory. Designed for use in ambient temperatures ranging from -40°C to 55°C when suspended 18" off ceiling. Surface mount to 45°C ambient operation.

LISTINGS — CSA listed. Damp location listed.

DesignLights Consortium® (DLC) Premium qualified product. Not all versions of this product may be DLC $Premium\ qualified.\ Please\ check\ the\ DLC\ Qualified\ Products\ List\ at\ \underline{www.designlights.org/QPL}\ to\ confirm$ which versions are qualified.

BUY AMERICAN ACT — Product with the BAA option is assembled in the USA and meets the Buy America(n) government procurement requirements under FAR, DFARS and DOT regulations. Please refer to www.acuitybrands.com/buy-american for additional information.

WARRANTY — 5-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at: www.acuitybrands.com/support/warranty/

Note: Actual performance may differ as a result of end-user environment and application. All values are design or typical values, measured under laboratory conditions at 25 °C. The product images shown are for illustration purposes only and may not be an exact representation of the product.

Specifications subject to change without notice.

Standard Part Number	Stock Part Number	Stock Part Number Cl Code	DLC Product ID	DLC Premium?
CPHB 12000LM SEF GCL MD MVOLT GZ10 40K 80CRI DWH	CPHB 12LM MVOLT 40K	*268SAH	PAMXQBT8	Yes
CPHB 12000LM SEF GCL MD MVOLT GZ10 50K 80CRI DWH	CPHB 12LM MVOLT 50K	*2681J0	P0Q23DMQ	Yes
CPHB 15000LM SEF GCL MD MVOLT GZ10 40K 80CRI DWH	CPHB 15LM MVOLT 40K	*2681J2	PLPPHUFG	Yes
CPHB 15000LM SEF GCL MD MVOLT GZ10 50K 80CRI DWH	CPHB 15LM MVOLT 50K	*2681J5	PJ97Z0F9	Yes
CPHB 18000LM SEF GCL MD MVOLT GZ10 40K 80CRI DWH	CPHB 18LM MVOLT 40K	*268SAJ	PWHG1E01	Yes
CPHB 18000LM SEF GCL MD MVOLT GZ10 50K 80CRI DWH	CPHB 18LM MVOLT 50K	*2681J9	PSRNYSS1	Yes
CPHB 24000LM SEF GCL MD MVOLT GZ10 40K 80CRI DWH	CPHB 24LM MVOLT 40K	*2681JE	PC2IBASD	Yes
CPHB 24000LM SEF GCL MD MVOLT GZ10 50K 80CRI DWH	CPHB 24LM MVOLT 50K	*2681JL	P7DUT85I	Yes
CPHB 30000LM SEF GCL MD MVOLT GZ10 40K 80CRI DWH	CPHB 30LM MVOLT 40K	*2681JM	PRXQVN2Q	Yes
CPHB 30000LM SEF GCL MD MVOLT GZ10 50K 80CRI DWH	CPHB 30LM MVOLT 50K	*2681JP	PDAUA08P	Yes

atalog umber	
otes	
/pe	

LED High Bay

COMPACT PRO

9,000 through 60,000 Lumens













ds design select

Items marked by a shaded background qualify for the Design Select program and ship in 15 days or less. To learn more about Design Select, visit www.acuitybrands.com/designselect. *See ordering tree for details





ORDERING INFORMATION

Lead times will vary depending on options selected. Consult with your sales representative.

Example: CPHB 24000LM SEF GCL MD 120 GZ10 40K 80CRI CPSBW LSXR6 HL DWH

СРНВ				GCL			GZ10		
Series		Lumens	Performance Package	Lens	Distribution	Voltage	Driver	Color Temperature	Color Rendering Index
	Compact Pro High Bay	9000LM 9,000 lumens 12000LM 12,000 lumens 15000LM 15,000 lumens 18000LM 18,000 lumens 24000LM 24,000 lumens 30000LM 30,000 lumens 36000LM 36,000 lumens 48000LM 48,000 lumens 60000LM 60,000 lumens	SEF Standard Efficiency HEF High Efficiency	GCL Glare Control Lens	MD Medium Distribution ND Narrow Distribution WD Wide Distribution	MVOLT 120-277V 120 120V 208 208V 240 240V 277 277V 347 347V \$\ddots\$ 480 480V \$\ddots\$ HVOLT 347-480V \$\ddots\$	GZ10 0-10V dimming driver	35K 3500 K 40K 4000 K 50K 5000 K	70CRI 70 CRI 80CRI 80 CRI 90CRI 90 CRI

BAA Buy America(n) Act Compliant Emergency Dottons: # Individual Controls (LSXR): #					DWH	
Emergency Options: \$ E10WCP 10W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E20WCPHE 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15WMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15W 60 MAEDS \$ E15W 60 MED 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15W 60 MED 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15W 60 MED 15W emergency battery pack, Certified in CA Title 20 MAEDBS \$ E15W 60 Mile amplication of CA Title 20 MAEDBS \$ E15W 60 Mile amplication in CA Title 20 MAEDBS \$ E15W 60 Mile amplication in CA Title 20 MAEDBS \$ E15W 60 Mile amplication in CA	Options				Finish	
EISWMCP 10W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emergency battery pack, Certified in CA Title 20 MAEDBS † EISWMCP 16W emer	BAA	Buy America(n) Act Compliant	Individual Controls (I	LSXR): ‡	DWH	Gloss White
EISWKCP 10W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ EISWMCP 10W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 10W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWMCP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWACP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWACP 20W emergency battery pack, Certified in CA Title 20 MAEDBS ‡ IEISWACP 20W emergency battery pack, Certified in CA Title 20 MAEDBS † IEISWACP 20W emergency battery pack, Certified in CA Title 2			LSXR6	360° integral high mount motion sensor with standard on/off operation		
IETOWMCP 10W emergency battery pack, Certified in CA Title 20 MAEDBS # 15W emergency battery pack, Certified in CA Title		•	LSXR6 HL			
IETSWMCP 15W emergency battery pack, Certified in CA Title 20 MAEDBS	E15WMCP	15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡	LSXR6 P	360° integral high mount motion sensor with on/off switching photocell		
IE20WCPHE MAEDS‡ Generator Transfer Device ‡ WGX Wireguard installed Integrated modular plug ‡ SPD Additional 10kV surge protection device ‡ RELCC*-Ready luminaire. (Not available with Haleon sensor options). See page 13 for ordering information OCS RELOC* OnePass selectable cable of installed ± COS4C RELOC* OnePass selectable cable of installed ± Adviron factory installed battery with 3-conductor cordset or Reloc, with on/off controlled by sensor rather than switch, the normal hot and unswitched hot wired together in the fixture. (Consult local codes to determine if this is allowable plug (voltage will match fixture, 120V or 277V only) CPTLW G' White damp location cord with 15 amp twist-lock plug (voltage will match fixture) \$ CPTL20AW G' White damp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CPTL20AW G' White damp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CPTL20AW G' white cdamp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CPTL20AW G' white cdamp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CPTL20AW G' white cdamp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CPTL20AW G' white cdamp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CPTL20AW G' white cdamp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CPTL20AW G' white cdamp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CPTL20AW G' white cord, 4 conductors (for use with battery) Soo' integral high mount motion sensor; Replace "G' in nomenclature with "10". For High Mount AISLEWAY Soo' integral high mount motion sensor with High/Low (Off) occupancy detection; Bluetooth enabled HLN45 AD 360' integral high mount motion sensor with High/Low (Off) occupancy operation with plught location to mother and the fixture of integral high mount motion sensor with High/Low (Off) occupancy and unto dimming of functional dim	IE10WMCP	10W emergency battery pack, Certified in CA Title 20 MAEDBS ‡	LSXR6 ADC	360° integral high mount motion sensor with dimming & switching photocell		
#For 360° integral LOW MOUNT sensors, replace "6" in nomenclature with "10". For High Mount AISLEWAY sensors, replace "6" in nomenclature with "50". Ex: LSXR50 HL #For 360° integral LOW MOUNT sensors, replace "6" in nomenclature with "10". For High Mount AISLEWAY sensors, replace "6" in nomenclature with "50". Ex: LSXR50 HL #for 360° integral LOW MOUNT sensors, replace "6" in nomenclature with "10". For High Mount AISLEWAY sensors, replace "6" in nomenclature with "50". Ex: LSXR50 HL #INM5 9CC #INM6 9CC #INM5 9CC #INM6 9CC #INM5 9CC #INM5 9CC #INM5 9CC #INM5 9CC #INM5 9CC #INM5 9CC #INM6 9CC #IN	IE15WMCP	15W emergency battery pack, Certified in CA Title 20 MAEDBS ‡	LSXR6 ANL	360° integral high mount motion sensor with High/Low occupancy dimming &		
ETS Generator Transfer Device \$ WGX Wireguard installed IMP Integrated modular plug \$ SPD Additional 10kV surge protection device \$ RRL_ RELOC** Ready luminaire. (Not available with Haleon sensor options). See page 13 for ordering information OCS RELOC** One Pass* selectable cable 6' installed \$ UCS4C RELOC** One Pass* selectable cable 6' installed. \$ UCS4C RELOC** One Pass* selectable text bie of installed. \$ UCS4C RELOC** One Pass* selectable text bie one bied text bied bied installed. \$ UCS4C RELOC** One Pass* selectable text bied bied installed. \$ UCS4C RELOC** One Pass* selectable text bied bied installed. \$ UCS4C RELOC** One Pass* selectable text bied bied installed. \$ UCS4C RELOC** One Pass* selectable text bied bied installed. \$ UCS4C RELOC** One Pass* selectable text bied bied installed. \$ UCS4C RELOC** One Pass* selectable text bied bied bied installed. \$ UCS4C RELOC** One Pass* sele	IE20WCPHE			31		
Wifey wite damp location cord with Staight blade plug (voltage will match fixture) Wifey and wife damp location cord with 15 amp twist-lock plug (voltage will match fixture) Wifey and wife damp location cord with 20 amp twist lock plug (voltage will match fixture) Wifey and wifey an	FTS		*For 360° integral LC sensors replace "6"	IW MOUNT sensors, replace "6" in nomenclature with "10". For High Mount AISLEWAY ' in nomenclature with "50" Fx: LSXR50 HI		
IMP Integrated modular plug \$ SPD Additional 10kV surge protection device \$ RRL RELOC* Ready luminaire. (Not available with Haleon sensor options). See page 13 for ordering information OCS RELOC* One Pass selectable cable 6' installed \$ OCS4C RELOC* One Pass selectable cable 6' installed \$ 2470 peration, factory installed battery with 3-conductor cordset or Reloc, with on/off controlled by sensor rather than switch, the normal hot and unswitched hot wired together in the fixture. Consult local codes to determine if this is allowable JP Job Pack \$ Cord Sets: \$ CPSBW 6' white damp location cord with 15 amp twist-lock plug (voltage will match fixture, 120V or 277V only) CPTLV 6' white damp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CPTLOAW 6' white cord, no plug CNP4CW 6' white cord, 4 conductors (for use with battery) Individual Controls with Bluetooth Programming (Haleon): \$ HLN45 ANC 360° integral high mount motion sensor with High/Low (Off) occupancy operation with photocell; Bluetooth enabled HLN45 ANL 360° integral high mount motion sensor with High/Low (Off) occupancy operation with photocell; Bluetooth enabled HLN45 ANL 360° integral high mount motion sensor with High/Low (Off) occupancy operation with photocell; Bluetooth enabled HLN45 ANL 360° integral high mount motion sensor with High/Low (Off) occupancy operation with photocell; Bluetooth enabled HLN45 ANL 360° integral high mount motion sensor with High/Low (Off) occupancy operation with photocell; Bluetooth enabled HLN45 ANL 360° integral high mount motion sensor with High/Low (Off) occupancy of integral high mount motion sensor with High/Low (Off) occupancy of integral high mount motion sensor with High/Low (Off) or unaintegral town of integral high mount motion sensor with High/Low (Off) or unaintegral high mount motion sensor with High/Low (Off) or unaintegral high mount motion sensor with High/Low (Off) or unaintegral high mount motion sensor with High/Low (Off) or unaintegral high mount motion sen	1		sensors, replace o	III HOMERICA WATER SO . EXCESSIONE		
SPD Additional 10kV surge protection device \$ RRL_RELOC*-Ready luminaire. (Not available with Haleon sensor options). See page 13 for ordering information OCS RELOC* One Pass selectable cable of installed \$ OCS4C RELOC* One Pass selectable cable of installed. \$ 2470P 24/7 operation, factory installed battery with 3-conductor cordset or Reloc, with on/off controlled by sensor rather than switch, the normal hot and unswitched hot wired together in the fixture. Consult local codes to determine if this is allowable JP Job Pack \$ Cord Sets: \$ CPSBW 6' white damp location cord with straight blade plug (voltage will match fixture) \$ CPTLOWW 6' white damp location cord with 15 amp twist-lock plug (voltage will match fixture) \$ CPTLOWW 6' white damp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CNPW 6' white cord, no plug CNP4CW 6' white cord, 4 conductors (for use with battery) HIN45 OCC 360° integral high mount motion sensor with High/Low (Off) occupancy detection; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor. High /Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor. High /Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor, High /Low / Off occupancy operation, factory installed battery of functionality due to photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor, High /Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor, High /Low / Off occupancy operation, factory installed battery of functionality due to photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor, High /Low / Off occupancy operation, factory installed battery of functionality due to photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor, High /Low /Off occupancy operation with High/Low (Off occupancy operation with High/Low (Off occupancy operation with	-	,	<u>Individual Controls v</u>	vith Bluetooth Programming (Haleon): ‡		
RRL_ RELOC®-Ready luminaire. (Not available with Haleon sensor options). See page 13 for ordering information OCS RELOC® One Pass selectable cable 6 installed \$ OCS4C RELOC® One Pass selectable cable 6 installed \$ 2470 P 24/7 operation, factory installed battery with 3-conductor cordset or Reloc, with on/off controlled by sensor rather than switch, the normal hot and unswitched hot wired together in the fixture. Consult local codes to determine if this is allowable JP Job Pack \$ Cord Sets: \$ CPSBW 6' white damp location cord with 15 amp twist-lock plug (voltage will match fixture, 120V or 277V only) CPTLW 6' white damp location cord with 15 amp twist-lock plug (voltage will match fixture) \$ CPTLOAW 6' white cord, no plug CNP4CW 6' white cord, a 4 conductors (for use with battery) HLN45 ADC 360° integral high mount motion sensor with High/Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor. High / Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor. High / Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor with High/Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor. High / Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor. High / Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor. High / Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor. High / Low / Off occupancy and integral high mount motion sensor with High/Low / Off occupancy off functionality due to photocell; Bluetooth enabled HLN45 ADC 360° integral high mount motion sensor. High / Low / Off occupancy and high mount occupancy and late of functionality due to photocell; Bluetooth enabled HLN45 ADC 160° integra		3 1 3	HLN45 OCC	360° integral high mount motion sensor; Bluetooth enabled LINK		
options). See page 13 for ordering information OCS RELOC® OnePass selectable cable 6' installed \$ OCS4C RELOC® One Pass selectable cable 6' installed. \$ 24/70 peration, factory installed battery with account or cordset or Reloc, with on/off controlled by sensor rather than switch, the normal hot and unswitched hot wired together in the fixture. Consult local codes to determine if this is allowable JP Job Pack \$ Cord Sets: \$ CPSBW 6' white damp location cord with 15 amp twist-lock plug (voltage will match fixture) CPTLOAW 6' white damp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CPTLOAW 6' white cord, no plug CNP4CW 6' white cord, a conductors (for use with battery) Selectable cable 6' installed \$ HLN45 ADC 360' integral high mount motion sensor. High / Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ANL 360' integral high mount motion sensor with High/Low occupancy and auto dimming / off functionality due to photocell; Bluetooth enabled HLN45 ANL 360' integral high mount motion sensor. High / Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ANL 360' integral high mount motion sensor. High / Low / Off occupancy operation with photocell; Bluetooth enabled HLN45 ANL 360' integral high mount motion sensor with High/Low occupancy and auto dimming / off functionality due to photocell; Bluetooth enabled HLN45 ANL 360' integral low House sensor with High/Low occupancy and auto dimming / off functionality due to photocell; Bluetooth enabled HLN45 ANL 360' integral low House sensor with High/Low occupancy and auto dimming / off functionality due to photocell; Bluetooth enabled HLN45 ANL 360' integral low House sensor with High/Low occupancy and auto dimming / off functionality due to photocell; Bluetooth enabled HLN45 ANL 360' integral high mount motion sensor with High/Low occupancy and auto dimming / off functionality due to photocell; Bluetooth enabled HLN45 ANL 360' integral high mount motion sensor with High/Low occupancy and		3 1	HLN45 HL	360° integral high mount motion sensor with High/Low (Off) occupancy detection;		
OCS C RELOC® One Pass® selectable cable 6' installed. \$ 2470						
OCS4C RELOC® One Pass® selectable cable 6' installed. ‡ 24/70 peration, factory installed battery with 3-conductor cordset or Reloc, with on/off controlled by sensor rather than switch, the normal hot and unswitched hot wired together in the fixture. Consult local codes to determine if this is allowable JP Job Pack ‡ Cord Sets: ‡ CPSBW 6' white damp location cord with straight blade plug (voltage will match fixture, 120V or 277V only) CPTLU 6' white damp location cord with 15 amp twist-lock plug (voltage will match fixture) \$ CPTL20AW 6' white damp location cord with 20 amp twist lock plug (voltage will match fixture) \$ CNPW 6' white cord, no plug CNP4CW 6' white cord, 4 conductors (for use with battery) HLN45 ANL 360° integral high mount motion sensor with High/Low occupancy and auto dimming / off functionality due to photocell; Bluetooth enabled **ILN45 ANL 360° integral high mount motion sensor with High/Low occupancy and auto dimming / off functionality due to photocell; Bluetooth enabled **ILN45 ANL 360° integral high mount motion sensor with High/Low occupancy and auto dimming / off functionality due to photocell; Bluetooth enabled **ILN48 ANL 360° integral high mount motion sensor with High/Low occupancy and auto dimming / off functionality due to photocell; Bluetooth enabled **ILN48 ANL 360° integral high mount occupancy and daylight sensor unity functionality due to photocell; Bluetooth enabled **ILN48 ANL 360° integral high mount occupancy and daylight sensor unity functionality due to photocell; Bluetooth enabled **ILN48 ANL 360° integral high mount occupancy and daylight sensor unity functionality due to photocell; Bluetooth enabled **ILN48 ANL 360° integral high mount motion sensor with High/Low occupancy and daylight sensor unity functionality due to photocell; Bluetooth enabled **ILN48 ANL 360° integral high mount occupancy and late (wireless) gen 2 control device with high mount occupancy and daylight sensor unity functionality due to photocell; Bluetooth enabled **For 360° inte	OCS		HLN45 ADC	360° integral high mount motion sensor. High / Low / Off occupancy operation with		
24/7 operation, factory installed battery with 3-conductor cordset or Reloc, with on/off controlled by sensor rather than switch, the normal hot and unswitched hot wired together in the fixture. Consult local codes to determine if this is allowable JP	OCS4C	RELOC® One Pass® selectable cable 6' installed. ‡	HI N45 ANI	F		
switch, the normal hot and unswitched hot wired together in the fixture. Consult local codes to determine if this is allowable JP Job Pack ‡ Cord Sets: ‡ CPSBW 6' white damp location cord with 15 amp twist-lock plug (voltage will match fixture) CPTLW 0' white damp location cord with 15 amp twist-lock plug (voltage will match fixture) ‡ CPTL20AW 6' white damp location cord with 20 amp twist lock plug (voltage will match fixture) ‡ CNPW 6' white cord, no plug CNP4CW 6' white cord, 4 conductors (for use with battery)	2470P					
the fixture. Consult local codes to determine if this is allowable JP Job Pack ‡ Cord Sets: ‡ CPSBW 6' white damp location cord with straight blade plug (voltage will match fixture, 120V or 277V only) CPTLW 6' white damp location cord with 15 amp twist-lock plug (voltage will match fixture) CPTL20AW 6' white damp location cord with 20 amp twist lock plug (voltage will match fixture) ‡ CNPW 6' white cord, no plug CNP4CW 6' white cord, 4 conductors (for use with battery) NLTAIR2 RLSXR6 n.Light AIR (wireless) gen 2 control device with high mount occupancy and daylight sensor INTAIR2 RMSOD45 Embedded n.Light AIR (wireless) gen 2 control device with high mount occupancy and daylight sensor LINK ‡ *For 360° integral Low Mount sensors, replace "45" in nomenclature with "7". For high Aisle Mount sensors, replace "45" with "45A". Ex: NLTAIR2 RMSOD45A		cordset or Reloc, with on/off controlled by sensor rather than		•		
Section Cord Sets: # CPSBW 6' white damp location cord with straight blade plug (voltage will match fixture, 120V or 277V only)						
COT Sets: ‡ CPSBW 6' white damp location cord with straight blade plug (voltage will match fixture, 120V or 277V only) CPTLW 6' white damp location cord with 15 amp twist-lock plug (voltage will match fixture) CPTL20AW 6' white damp location cord with 20 amp twist lock plug (voltage will match fixture) ‡ CNPW 6' white cord, no plug CNP4CW 6' white cord, 4 conductors (for use with battery) NLTAIR2 RMS0D45 Embedded nLight AIR (wireless) gen 2 control device with high mount occupancy and daylight sensor LINK ‡ *For 360° integral LOW MOUNT sensors, replace "6" in nomenclature with "50". Ex: RLSXR50 NLTAIR2 RMS0D45 Embedded nLight AIR (wireless) gen 2 control device with high mount occupancy and daylight sensor LINK ‡ *For 360° integral LOW Mount sensors, replace "45" in nomenclature with "7". For high Aisle Mount sensors, replace "45" with "45A". Ex: NLTAIR2 RMS0D45A	IP					
CPSBW 6' white damp location cord with straight blade plug (voltage will match fixture, 120V or 277V only) CPTLW 6' white damp location cord with 15 amp twist-lock plug (voltage will match fixture) CPTL20AW 6' white damp location cord with 20 amp twist lock plug (voltage will match fixture) # CNPW 6' white cord, no plug CNP4CW 6' white cord, 4 conductors (for use with battery) "For 360' integral LOW MOUNT sensors, replace "6" in nomenclature with "50". Ex: RLSXR50 NLTAIR2 RMS0D45 Embedded nLight AIR (wireless) gen 2 control device with high mount occupancy and daylight sensor LINK # "For 360" integral LOW MOUNT sensors, replace "6" in nomenclature with "70". For High Mount AISLEWAY *For 360" integral LOW MOUNT sensors, replace "6" in nomenclature with "50". Ex: RLSXR50 NLTAIR2 RMS0D45 Embedded nLight AIR (wireless) gen 2 control device with high mount occupancy and daylight sensor LINK # "For 360" integral LOW MOUNT sensors, replace "6" in nomenclature with "50". Ex: RLSXR50 NLTAIR2 RMS0D45 Embedded nLight AIR (wireless) gen 2 control device with high mount occupancy and daylight sensor LINK # "For 360" integral LOW MOUNT sensors, replace "6" in nomenclature with "50". Ex: RLSXR50	-	Job i dell'		3 1 73 1 7		
(voltage will match fixture, 120V or 277V only) CPTLW 6' white damp location cord with 15 amp twist-lock plug (voltage will match fixture) CPTL20AW 6' white damp location cord with 20 amp twist lock plug (voltage will match fixture) CNPW 6' white cord, no plug CNP4CW 6' white cord, 4 conductors (for use with battery)		6' white damp location cord with straight blade plug				
(voltage will match fixture) CPTL20AW 6' white damp location cord with 20 amp twist lock plug (voltage will match fixture) ‡ CNPW 6' white cord, no plug CNP4CW 6' white cord, 4 conductors (for use with battery)	CI JUW		sensors, replace o i	IN NOMERICIALURE WILL DO . EX. KLDAKDU		
(voltage will match fixture) CNPW 6' white cord, no plug CNP4CW 6' white cord, 4 conductors (for use with battery)	CPTLW		NLTAIR2 RMSOD45			
CNP4CW 6' white cord , 4 conductors (for use with battery)	CPTL20AW					
	CNPW	6' white cord, no plug				
CNPSCDW 6' white cord, 5 conductors (includes dimming leads)	CNP4CW	6' white cord , 4 conductors (for use with battery)				
	CNP5CDW	6' white cord, 5 conductors (includes dimming leads)				

Accessories: Order	as separate catal	og number.
--------------------	-------------------	------------

Mounting: IBAC120 M100 Aircraft cable 10' with hook (one pair) IBAC240 M75 Aircraft cable 20' with hook (one pair) **IBHMP** Hook monopoint CPHBPMPSM Pendant Monopoint splice box with 3/4" hub (for 9000LM - 18000LM) CPHBPMPMD Pendant Monopoint splice box with 3/4" hub (for 24000LM - 30000LM) CPHBPMPLG Pendant Monopoint splice box with 3/4" hub (for 36000LM - 60000LM) ZACVH Aircraft 10' V hanger (one pair) HC36 Hanger chain, 36" (one pair)

Tong hanger surface mount bracket ‡

Wire guards:
WGCPHBSM Wire guard for CPHB (9000LM - 18000LM)
WGCPHBMD Wire guard for CPHB (24000LM - 30000LM)
WGCPHBLG Wire guard for CPHB (36000LM - 60000LM)



Cord sets for IMP option: ‡

 CSTWIMP
 Straight plug, 120V

 CS3WIMP
 Twist-lock, 120V

 CS7WIMP
 Straight plug, 277V

 CS11WIMP
 Twist-lock, 277V

 CS93WIMP
 600V SO white cord, no plug

(no voltage required)

LITHONIA LIGHTING

THUN J2

	‡ Option Value Ordering Restrictions
Option Value	Ordering Restrictions
18000LM	Not available with HVOLT. When 18000LM requires 347 or 480 volt; the fixture utilizes a step-down transformer.
2470P	Requires cord or reloc, battery and sensor options. Not available with 4 conductor cord sets or Individual controls with dimming options. CPHB will be wired from the factory for 24/7 operation (via cord or Reloc), with on/off controlled by sensor rather than switch. Consult local codes to determine if this is allowable.
347	Fixture includes an additional 10kV surge protector. When ordered with 18000LM, includes step down transformer.
480	Fixture includes an additional 10kV surge protector. When ordered with 18000LM, includes step down transformer.
Cord Sets	Must specify voltage on cord sets with plugs.
Cord Sets for IMP	Fixture must be ordered with IMP option. All cord sets are 18/3, 6' white.
CPHBPMPSM/MD/LG	Pendant monopoint splice boxes will require wiring from access plate to splice box KO if power is being dropped through pendant conduit. Fixture does not have a KO in center to pull power out of driver channel through splice box.
CPTL20AW	Required on 347 and 480 volt.
Emergency Options	May alter fixture construction. Consult line art for dimensions. Batteries not for use with pendant mount option. If cord set is needed, use CNP4CW which will have normal hot and unswitched hot exiting cord set. Not available with IMP or ETS option.
E10WCP	MVOLT only. Max ambient operating temperature of 35°C. Includes an additional 10kV surge protector on the unswitched, battery hot.
E15WMCP	MVOLT only. Factory installation only. Not approved for field installation. Max ambient operating temperature of 35°C. Includes an additional 10kV surge protector on the unswitched, battery hot.
ETS	MVOLT only. Not available with cord sets or batteries. When sensor is required, use "ER" sensor option. Utilizes ETS 924 DR component. Includes an additional 10kV surge protector
HVOLT	Fixture includes an additional 10kV surge protector. Not valid with 18000LM. Not available with Haleon sensor options.
IE10WMCP	Available with 347 or 480 only. Not available with 18000LM.
IE15WMCP	Available with 347 or 480 only. Not available with 9000LM, 12000LM, 15000LM, or 18000LM.
IE20WCPHE	MVOLT only. Not available for 9LM, 12LM, 15LM and 18LM. Not available with RPP20 and Cordset together. Not for use with THUN.
IMP	Not available with battery options, NLTAIR2 RPP20 D options, LSXR ER options, ETS, or NLTAIR2 RLSXR ER options. Sensors will be fixture pre-wired to fixture. Not for use with THUN mounting option.
Individual Controls (LSXR)	Comes standard with SPD. This sensor configuration is suitable for minimum ambient temperature of $14^{\circ}F$ ($-10^{\circ}C$). Not available with other controls.
Individual Controls with Bluetooth Programming (Haleon)	Not available with HVOLT.
JP	Consult table on page 7 for details.
NLTAIR2 RMSOD	When HVOLT, 347, and 480 are ordered fixture utilizes fixture back pack. Not available with battery options when 347, 480 or HVOLT are ordered. Not available with ETS when ordered with 9000LM, 12000LM, 15000LM or 18000LM lumen packages. Available with EM option by adding EM to nomenclature. Ex: NLTAIR2 RMSOD45 EM. When EM option is ordered, not available with emergency battery packs.
OCS	Must specify voltage. Dry Location listed only.
OCS4C	Dry location listed only. Use when unswitched hot is required for battery pack options.
SPD	10kV surge protector standard with HVOLT, 347, 480, ETS, LSXR, RLSXR, RPP20, and battery options (on the unswitched, battery hot).
THUN J2	Order quantity required in multiples of two. 9000LM - 18000LM requires one per fixture, 24000LM - 60000LM requires two per fixture. Not for use with IMP or IE20WCPHE option.

CORD SET ORDERING INFORMATION

Cord sets cannot be ordered as accessories

Plug Option Plug type	Amperage**	Gauge	# of conductors	Color	Location	Length****
CNP Cord Only CP Cord with Plug TL Locking Type SB Straight blade*	(blank) 15 amps 20A 20 amps***	(blank) 18 gauge standard	(blank) 3 conductors (blk/wht/grn) 4C 4 conductors; Use with Battery option when unswitched hot is needed 5C 5 conductors; Use when fixture has 2 drivers and separate operation is required 5CD**** 5 conductors; Use with dimming driver when dimming leads are desired (Not for use with dimming sensors)	W White	(blank) Damp Location	(blank) 6 feet 3FT 3 feet 10FT 10 feet 12FT 12 feet 15FT 15 feet 20FT 20 feet

^{*} Straight blade on available with 120, 208, 240, and 277 volt.

^{**} Amperage is only configurable for cords with plugs.

^{*** 20}A required with 347 and 480 volt.

^{****} Not available with plugs.

^{*****} Available in 1' increments from 1 to 30 feet.

PHOTOMETRICS

PERFORMANCE TABLE

	Glare Control Lens, Medium Distribution				
CPHB SEF	Lumen Package	Wattage	Lumen Output	LPW	
	9000LM	61	9,123	150	
	12000LM	87	12,273	141	
	15000LM	102	15,343	150	
Delivered	18000LM	133	18,199	137	
Lumens	24000LM	174	24,873	143	
4000K, 80CRI	30000LM	210	29,825	142	
	36000LM	235	36,289	163	
	48000LM	324	48,342	153	
	60000LM	421	58,946	140	

	9000LM	61	9,183	150
	12000LM	88	12,354	140
	15000LM	105	15,444	147
Delivered	18000LM	133	18,319	138
Lumens	24000LM	174	25,037	144
5000K, 80CRI	30000LM	210	30,081	143
	36000LM	235	36,529	155
	48000LM	324	48,661	150
	60000LM	421	59,452	141

^{*}Values shown are at 120V.

See www.lithonia.com.

	Glare Control Lens, Medium Distribution					
CPHB HEF	Lumen Package	Wattage	Lumen Output	LPW		
	9000LM	55	8,861	161		
	12000LM	75	12,056	161		
	15000LM	96	14,875	155		
Delivered	18000LM	127	18,936	149		
Lumens	24000LM	150	23,740	158		
4000K, 80CRI	30000LM	196	29,644	152		
	36000LM	210	35,409	169		
	48000LM	292	47,480	163		
	60000LM	378	59,274	157		

	9000LM	55	9,002	164
	12000LM	75	12,248	163
	15000LM	96	15,111	157
Delivered	18000LM	127	19,236	151
Lumens	24000LM	150	24,117	161
5000K, 80CRI	30000LM	196	30,115	154
	36000LM	210	35,971	171
	48000LM	292	48,234	165
	60000LM	378	60,215	159

SCALING FACTOR TABLES

Multipliers				
ND	1.037			
WD	1.004			
WGX	0.95			

CPHB CHARACTERISTICS

	1								1		1		
Lumen	Cas	andard Eff	Seioneu (C		tage	Uiah Effici	on av (UEF		Length Width Depth		Weight		
package	30	andard Eff					ency (HEF	1				Shown in	Comparable light source
	120V	277V	347V	480V	120V	277V	347V	480V	Dimensions shown in inches (centimeters)		pounds (kg)		
9000LM	61	60	60	60	55	54	54	54	14.4 (36.6)	11.5 (29.2)	2.3 (5.8)	5 (2.2)	100W MH, 4-lamp T8 NBF
12000LM	88	88	88	87	75	74	74	74	14.4 (36.6)	11.5 (29.2)	2.3 (5.8)	5 (2.2)	175W MH, 4-lamp T8 HBF, 2-lamp T5H0
15000LM	105	104	104	103	96	95	95	94	14.4 (36.6)	11.5 (29.2)	2.3 (5.8)	5 (2.2)	200W MH, 6-lamp T8 NBF
18000LM	133	132	144	144	127	126	138	138	14.4 (36.6)	11.5 (29.2)	2.3 (5.8)	6.5 (2.9)	250W MH, 6-lamp T8 HBF, 4-lamp T5H0
24000LM	174	174	173	173	150	149	149	149	22.8 (57.9)	11.5 (29.2)	2.3 (5.8)	8 (3.6)	400W MH, 6-lamp T5H0
30000LM	210	209	208	208	196	194	194	194	22.8 (57.9)	11.5 (29.2)	2.3 (5.8)	8 (3.6)	575W MH, 10-lamp T8 HBF
36000LM	235	235	234	234	210	208	208	208	44 (111.8)	11.5 (29.2)	2.3 (5.8)	14 (6.35)	750W MH, 8-lamp T5H0
48000LM	324	322	320	320	289	287	286	285	44 (111.8)	11.5 (29.2)	2.3 (5.8)	14 (6.35)	875W MH, 10-lamp T5H0
60000LM	421	421	419	419	374	372	371	370	44 (111.8)	11.5 (29.2)	2.3 (5.8)	14 (6.35)	1000W MH

 $[\]hbox{*} Dimensions \& weights shown for standard product configurations without optional components$

PROJECTED LUMEN MAINTENANCE

Operating hours	10,000	20,000	30,000	40,000	50,000	60,000	70,000	80,000	90,000	100,000
Lumen maintenance factor	0.98	0.96	0.93	0.91	0.89	0.87	0.85	0.83	0.81	0.79

BATTERY INFORMATION

EMERGENCY BATTERY PACK OPTIONS

Nomenclature	Part Number	Utilizes BPK option	Field installable (remote mount only)	
E10WCP (MVOLT only)	<u>PS1055CP</u>	Yes	Yes	
E15WMCP (MVOLT only)	<u>PS1555MCP</u>	Yes	No	
IE10WMCP (HVOLT only)	ILBHI CP10 HE SD LCSTICK	Yes	No	
IE15WMCP (HVOLT only)	ILBHI CP15 HE SD LCSTICK	Yes	No	
IE20WCPHE (MVOLT only)	ILBLP CP20 HE SD	No	Yes	


	EMERGENCY	LUMENS GCL, MD (5	000K, 80CRI)		
	Lumen Package	E10WCP	E15WMCP		
	9000	1784	2738		
	12000	1778	2729		
	15000	1734	2701		
	18000	1796	2744		
SEF	24000	1847	2845		
	30000	1884	2868		
	36000	1890	2915		
	48000	1888	2912		
	60000	1872	2853		

	EMERGENCY	LUMENS GCL, MD (5	000K, 80CRI)
	Lumen Package	E10WCP	E15WMCP
	9000	1916	2911
	12000	1914	2909
	15000	1919	2914
	18000	1916	2898
HEF	24000	1966	2984
	30000	1945	2952
	36000	2058	3125
	48000	2057	3124
	60000	2065	3137


Emergency Batteries & Cord Sets - WIRING

When battery is ordered with a 3-conductor cord set and 24/7 operation

Ideal for use with battery + SENSOR to control fixture on/off based on occupancy. Order option 247OP to receive wired for this scenario. When 247OP is ordered driver black (Hot) and battery red (Hot) will be wired together inside driver channel.



When battery is ordered with a 4-conductor cord set...

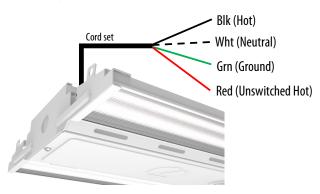


Emergency Batteries & Cord Set Notes

When a battery is ordered with a 3 conductor cord set, 2470P option is required. $\label{eq:conductor}$


The 3 conductor cord set will include the hot (BLK), neutral (WHT), and ground (GRN) conductors. 24/7 operation means the design intent is for the fixture to always receive power and never be switched off. This ensures the battery is always being charged. When 2470P is ordered with a 3/c cord set, the red battery hot will be wired to the normal hot inside the driver channel, and the new hot wire lead will exit the fixture with the ground and neutral wires. Consult local codes to determine if this is allowable.

When a battery is ordered with a 4 conductor cord set...


 The unswitched hot will be included in the cord set as a separate conductor (RED).




End View: CPHB 9000LM - 60000LM




Side View: 9000LM, 12000LM, 15000LM, 18000LM




Side View: 24000LM, 30000LM




Side View: 36000LM, 48000LM, 60000LM




CPHB 9000LM - 18000LM WITH E10WCP/E15WMCP







CPHB 24000LM - 30000LM WITH E10WCP/E15WMCP

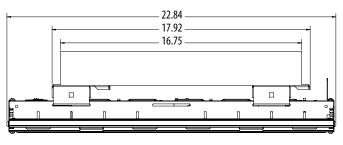


CPHB 24000LM - 30000LM WITH IE20WCPHE



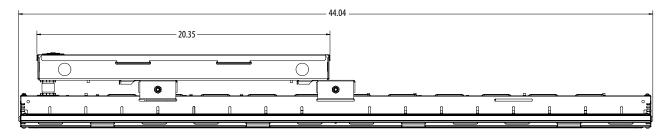


CPHB 36000LM - 60000LM WITH E10WCP/E15WMCP

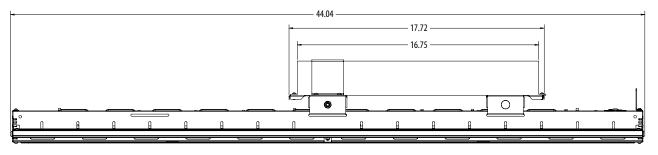

CPHB 36000LM - 60000LM WITH IE20WCPHE

JOB PACK DETAILS

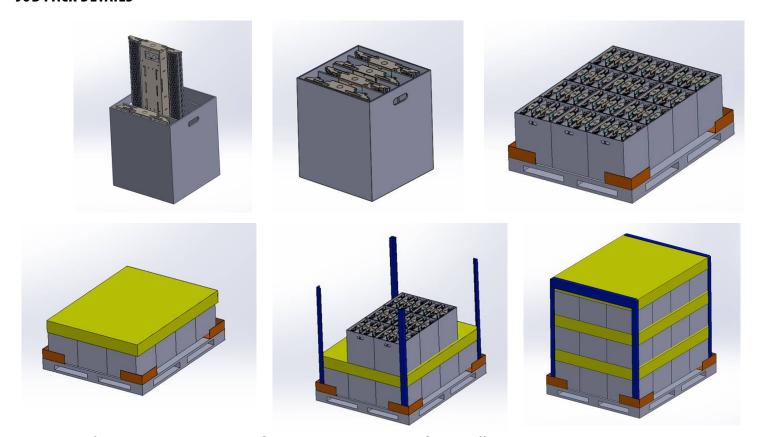

*Representative of Job Pack design for 14" standard units.

Series	Performance	Lumens	Standard Fixture	Cord Set or RELOC® JP	Wireguard JP	Sensor JP	
		9000LM					
		12000LM	144	144	144	00*	
		15000LM	144	144	144	90*	
		18000LM					
СРНВ	SEF/HEF	24000LM	06	06	06	60*	
		30000LM	96	96	96	60"	
		36000LM					
		48000LM	45*	30*	30*	30*	
		60000LM					

^{*}Traditional Job Pack

	Breakout Example:								
Ordered Line:	Qty: 200	CPHB 24000LM SEF GCL MD MVOLT GZ10 40K 80CRI CNPW DWH JP							
		*Above configuration shows 96 units for Job Pack							
Breakout Line 1: Qty: 19		CPHB 24000LM SEF GCL MD MVOLT GZ10 40K 80CRI CNPW DWH JP96							
		*Will have 2 pallets of 96 units each in job packs							
Breakout Line 2:	Qty: 8	CPHB 24000LM SEF GCL MD MVOLT GZ10 40K 80CRI CNPW DWH							
		*Balance will ship in unit cartons							

Note: If quantity ordered is less than Job Pack quantity for that configuration, the breakout line will default to unit packs.

STANDARD SENSOR

		Standard Sensor or Control Device (commonly used with Battery Pack Option)	EM Solution (Used when switching single incoming hot to generator power)	ER Solution (Used when switching to generator power via a 2nd hot lead)
	Emergency Lighting Strategy	*Luminaire-integral battery pack and emergency driver *Generator transfer device	*Diesel genset emergency backup supply *Slow transfer inverter (>30ms) emergency backup supply	*Fast Transfer (FT) inverter emergency backup supply *Uninterruptible Power System (UPS) emergency
Emergency Operation Scenarios	Recommended Control Device Option	*Not specifically listed for emergency use. *Wired such that a separately listed emergency device provides emergency lighting power and/or control during loss of normal power scenarios.	*UL 924 listed *EM devices will remain at their high-end trim and ignore wireless lighting control commands, such as in the event of a normal power failure, unless a normal-power-sensed (NPS) broadcast is received at least every 8 seconds. *Using the CLAIRITY+ mobile app, EM devices must be associated with a group that includes a normal power sensing device to receive NPS broadcasts. *Only non-emergency rPP20, rLSXR, rSBOR, rSDGR, and nLight AIR luminaires with version 3.4 or later firmware can provide normal power sensing for EM devices. See specification sheets for control devices and luminaires for more information on options that support normal power sensing.	*UL 924 listed *Utilizes dedicated Normal Power sensing leads to initiate lighting current override during loss of normal power scenarios. *Requires connections to both emergency and normal power circuits.

			Standard Sensor or	EM Solution	ER Solution (Generator / Inverter	CPHB Standard Sensor Settings					
	Function	Sequence of Operations	Control Device	(Generator / Inverter powered with 1 hot)	on separate emergency circuit - 2 hots)	Vacancy Time Out	Dim to Off Time Delay	High Trim	Low Trim	Photocell Set Point	
	On/Off	Lights turn on when motion detected; Upon vacancy, Lights turn off after timeout.	LSXR6	-	LSXR6 ER	10 min	-	-	-	-	
	High/Low (Off)	Lights turn on to high trim when presence is detected; Upon vacancy, the lights dim to low trim after timeout and turn off after "Dim To Off" Time Delay. For High/Low (Never Off) function, bypass the relay by bringing power directly into driver rather than wiring hot through LSXR device.	LSXR6 HL	-	LSXR6 HL ER	10 min	2.5 min	100%	10% (Driver Low)"	-	
Standalone	Photocell	Lights turn on unless ambient light level is above set point; If ambient light levels in the space exceed the photocell set point, lights will turn off even during occupancy.	LSXR6 P	-	LSXR6 P ER	-	-	-	-	4 fc	
Sensors (Individual control per fixture)	Dimming + Photocell	Lights turn on when presence is detected unless ambient light level is above set point; Upon vacancy, the lights dim to low trim, then turn off after timeout; During occupancy, automatically raise and lower electric light level to maintain set point and turn off, depending on ambient light.	LSXR6 ADC	-	LSXR6 ADC ER	10 min	2.5	1	-	4 fc	
	Dimming + Photocell + High/Low	Lights turn on when presence is detected unless ambient light level is above set point; Upon vacancy, lights dim to low trim after timeout and remain at low trim until presence is detected; Automatically raise and lower electric light level to maintain set point during occupancy and during vacancy keeps lights at low trim if ambient light is not sufficient.	LSXR6 ANL	-	LSXR6 ANL ER	10 min	-	100%	10%	4 fc	
		Note: For 360° integral Low Mount s	sensors, replace "6" in no	menclature with "10". Ex. L	SXR10 P. For High Aisle Mou	nt sensors, replace	e "6" with "50".				


	1					,				
	On/Off	Lights turn on when motion detected; Upon vacancy, Lights turn off after timeout.	HLN45 OCC	-	HLN45 OCC ER	10 min	-	-	-	-
	High/Low (Off)	Lights turn on to high trim when presence is detected; Upon vacancy, the lights dim to low trim after timeout and turn off after "Dim To Off" Time Delay.	HLN45 HL	-	HLN45 HL ER	10 min	2.5 min	100%	10%	-
Bluetooth Sensors (Configurable via mobile Bluetooth app)	Dimming + Photocell	Lights turn on when presence is detected unless ambient light level is above set point; Upon vacancy, the lights dim to low trim during timeout; During occupancy, automatically raise and lower electric light level to maintain set point and turn off, depending on ambient light.	HLN45 ADC	-	HLN45 ADC ER	10 min	2.5 min	-	10%	50 fc
	Dimming + Photocell + High/ Low (Never Off)	Lights turn on when presence is detected unless ambient light level is above set point; Upon vacancy, lights dim to low trim after timeout and remain at low trim until presence is detected; Automatically raise and lower electric light level to maintain set point during occupancy and during vacancy keeps lights at low trim if ambient light is not sufficient.	HLN45 ANL	-	HLN45 ANL ER	10 min	Never off due to occupancy	100%	10%	50 fc
nLight AIR	Dimming + Photocell + Occupancy	Wirelessly programmable network sensor - On/Off control with dimming, occupancy detection, and daylight harvesting (Sensor embedded in fixture)	NLTAIR2 RMSOD45	RLSXR 6 EM	NLTAIR2 RMSOD45 ER	7.5 min	-	100%	30%	50 fc
Wireless Sensors	Dimming	imming Wirelessly programmable On/Off control with dimming - no sensor (Device embedded in fixture)		RPP20D EM	NLTAIR2 RIO ER	-	-	100%	10% (driver low)	-
					" in nomenclature with "7". EM de-rates fixture to Damp l	ocation.				

*All ER solutions include standard sensor or control device with a factory-installed lota ETS##-DR (UL924 bypass device). This device is integral to the fixture and will include a hot and neutral lead for the dedicated emergency circuit. MVOLT, 120-277 only. ER solutions are not available with the IMP option.

LSXR — Fixture Mount Occupancy Sensor (see <u>www.</u> <u>AcuityControls.com</u> for additional information)

- Three interchangeable lens options to satisfy multiple mounting heights and coverage pattern requirements.
- $\bullet \ Integrated \ mounting \ bracket \ drops \ lens \ down \ 3" \ from \ chase \ nipple.$
- Single or dual relay versions designed with robust protection from the harsh switching requirements of T5 and LED loads.
- Photocell and 0-10VDC dimming options.
- No PIR field calibration or sensitivity adjustments required.
- Sensor ambient temperature rating of 14°F (-10°C) to 131°F (55°C).

LSXR configuration	Comparable CMRB sensor	Old style sensor nomenclature
For shortest lead times us	se one of the follow	ing LSXR configurations
LSXR50 / LCOZU	CMRB 50	MSI
LSXR50 HL / LCHOSZU	CMRB 50 D	MSID
LSXR50 P / LCPZU	CMRB 50 P	MSIPED
LSXR6 / LAOZU	CMRB 6	MSI360
LSXR6 HL / LAHOSZU	CMRB 6 D	MSI360D
LSXR6 P / LAPZU	CMRB 6 P	MSI360PED





LSXR COVERAGE PATTERNS

HIGH MOUNT 360° LENS (#6)



- Best choice for 15 to 45 ft (4.57 to 13.72 m) mounting heights
- 15 to 20 ft (4.57 to 6.10 m) radial coverage overlaps area lit by a typical high bay fixture
- Excellent detection of large motion (e.g. walking) up to a 35 ft (10.76 m) mounting height
- Excellent detection of extra large motion (e.g. forklifts) up to a 45 ft (13.72 m) mounting height





HIGH MOUNT AISLEWAY LENS (#50)




- Provides a bi-directional coverage pattern ideal for warehouse racking
- 1.2xmountingheightequalsapproximatedetection range in either direction
- Typical 40 ft (12.19 m) mounting detects 50 ft (15.24 m) in either direction
- Superior aisleway coverage compared to a masked






- Best choice for large motion detection (e.g. walking)
- 360° conical shaped pattern
- Provides ~24ft (7.32 m) radial coverage (~2000 ft2) when mounted at 9 ft (2.74 m)
- 7 to 15 ft (2.13 to 4.57 m) mounting heights provide 16 to 36 ft (4.88 to 10.97 m) radial coverage
- Detection range improves when walking across beams compared to into beams

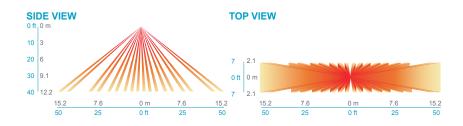



HALEON - Integrated Occupancy Sensor with Bluetooth® Programmability

- $\bullet \ Programmable \ sensor \ settings \ over \ Blue to oth ^{\texttt{@}} \ with \ Acuity \ VLP \ smartphone \ app.$
- Default programming options to service various application spaces occupancy detection, 0-10V dimming and daylight harvesting.
- 360° High Mount and High Mount Aiselway lens detection options for mounting heights up to 40 ft.
- Integrated retractable lens mask included to block unwanted detection.
- Sensor ambient temperature rating of -40°F (-40°C) to 158°F (70°C).





Haleon Default Programming


Model	Default Operation	LSXR Equivalent	Occupancy Time Delay	Photocell Mode	Photocell Set-point	Low Trim	High Trim	Dim to Off Time Delay
HLNxxx	On/Off Occupancy Only	LSXR6 LT or LAOOSTU	10 minutes	Disabled	n/a	n/a	100%	Disabled
HLNxxx HL	Occupancy w/ 0-10V Dimming (High/Low/Off)	LSXR6 HL LT or LAHOSTU	10 minutes	Disabled	n/a	10%	100%	2.5 minutes
HLNxxx ADC*	Occupancy w/ Dim & Switch Photocell	LSXR6 ADC LT or LAMOSTU	10 minutes	On/Off & Auto Dim	50 fc	10%	100%	2.5 min
HLNxxx ANL	Dim & Switch Photocell with High/Low Occupancy Operation	LSXR6 ANL LT or LAGOSTU	10 minutes	On/Off & Auto Dim	50 fc	10%	100%	Stay Dim/ Never off due to occupancy

Note: Lens detection noted in place of 'xxx'

HALEON COVERAGE PATTERNS


45- HIGH MOUNT 360°


- Optimized full coverage pattern for 10 50 ft. (3.1 12 m)
- Reliable detection of large motion (e.g. pedestrian walking traffic) up to 30 ft. (9.1 m) mounting height
- Reliable detection of extra-large motion (e.g. forklift traffic) up to 40 ft. (12 m) mounting height
- $\bullet \ Stow-able rotating lens shield can be utilized to mask areas in which detection is not desired$

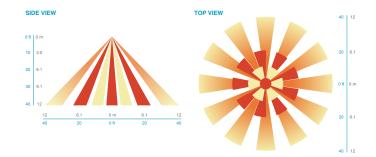

45A HIGH MOUNT AISLEWAY

- Optimized bi directional coverage pattern for aisleways with 10 50 ft. (3.1 12 m) mounting heights
- 1.2X's mounting height equals approximate detection range
- Reliable detection of large motion (e.g. pedestrian walking traffic) up to 30 ft. (9.1 m) mounting height
- Reliable detection of extra-large motion (e.g. forklift traffic) up to 40 ft. (12 m) mounting height
- Stow-able rotating lens shield can be utilized to mask areas in which detection is not desired






TOP VIEW

^{*}HLN ADC includes a 2.5 minute dim to off not found in LSXR ADC.

nLIGHT AIR CONTROLS - rLSXR

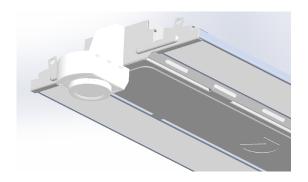



rLSXR COVERAGE PATTERNS

HIGH MOUNT 360° LENS (#6)



- Best choice for 15 to 45 ft (4.57 to 13.72 m) mounting heights
- 15 to 20 ft (4.57 to 6.10 m) radial coverage overlaps area lit by a typical high bay fixture
- Excellent detection of large motion (e.g. walking) up to a 35 ft (10.76 m) mounting height
- Excellent detection of extra large motion (e.g. forklifts) up to a 45 ft (13.72 m) mounting height






HIGH MOUNT AISLEWAY LENS (#50)




- Provides a bi-directional coverage pattern ideal for warehouse racking
- 1.2x mounting height equals approximate detection range in either direction
- Typical 40 ft (12.19 m) mounting detects 50 ft (15.24 m) in either direction
- Superior aisleway coverage compared to a masked 360° lens

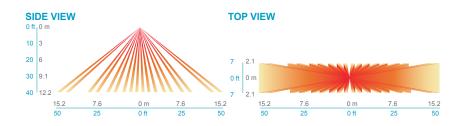

LOW MOUNT 360° LENS (#10)




- Best choice for large motion detection (e.g. walking)
- 360° conical shaped pattern
- Provides ~24ft (7.32 m) radial coverage (~2000ft2) when mounted at 9 ft (2.74 m)
- + 7 to 15 ft (2.13 to 4.57 m) mounting heights provide 16 to 36 ft (4.88 to 10.97 m) radial coverage
- Detection range improves when walking across beams compared to into beams

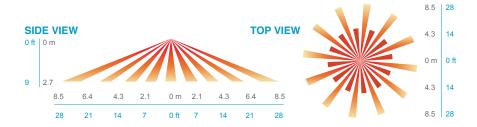

RMSOD

- 100% digital PIR detection
- Combined daylight and occupancy sensor
- Fully dimmable via digital or analog dimming protocols, providing the right amount of light for the application and to optimize energy savings
- Optional UL 924 emergency functionality via EM option, which eliminates wiring for sensing normal power

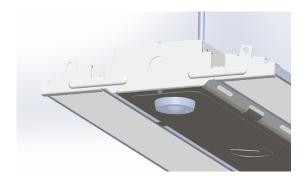


COVERAGE PATTERN

Lens rotates 15 deg to enable adjustment. Initial detection will occur earlier when walking across sensor's field of view than when walking directly at sensor.


7 - MINI LOW-BAY 360°

- Recommended for walking motion detection from mounting heights between 8 ft (2.44 m) and 20 ft (6.10 m)
- Initial detection of walking motion along sensor axis at distances of 2x the mounting height up to 15 ft (4.57 m)and 1.75x up to 20ft (6.10 m).
- Provides 12 ft (3.66 m) radial detection of small motion when mounted at 9 ft (2.74 m)

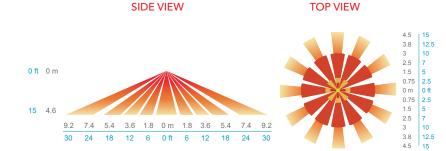


30 - UNIVERSAL 360°

- Provides excellent detection of large motion (e.g. walking) when mounted between 15 to 40 ft (4.57 to 12.19 m)
- 15 to 20 ft (4.57 to 6.10 m) radial coverage overlaps area lit by a typical high bay fixture
- Recommended for fixtures that have a 1:1 spacing to mounting height ratio or less (e.g. fixtures 30' on center or less @ a 30' mounting height).)

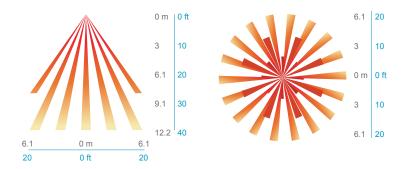

45 - HIGH MOUNT 360°

- Optimized full coverage pattern for 10 40 ft. (3.1 12 m)
- Reliable detection of large motion (e.g. pedestrian walking traffic) up to 30 ft. (9.1 m) mounting height
- Reliable detection of extra-large motion (e.g. forklift traffic) up to 40 ft. (12 m) mounting height

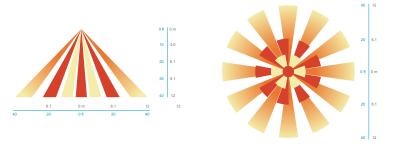

IMP - Integrated Modular Plug

- The integrated modular plug (IMP) option allows the installer to plug and play a multitude of accessories.
- Cord sets connect quickly to any fixture with IMP option.
- IMP accessories include occupancy sensors, photocells, X-point relays.

IMP compatible cord sets ¹	
CS1WIMP	Straight plug, 120V
CS3WIMP	Twist-lock, 120V
CS7WIMP	Straight plug, 277V
CS11WIMP	Twist-lock, 277V
CS25WIMP	Twist-lock, 347V
CS93WIMP	600V SE00W white cord, no plug
CS97WIMP	Twist-lock, 480V

Ordering Example

Order As: Qty 1 - IBG 12000LM SEF AFL GND 120 GZ10 40K 80CRI IMP CP5BW DWH Ships As: Qty 1 - IBG 12000LM SEF AFL GND MVOLT GZ10 40K 80CRI DWH Qty 1 - CS1WIMP

Notes

RRL - RELOC®-Ready Luminaire

- RRL connectors to be used with the OnePass system.
- Load side of connector factory installed to luminaire.
- 4-pole mating connector with push-in terminations allows for simple installation.
- Touch-safe design on both halves meets UL/CSA requirement.
- Wiping contact design allows safe disconnect under load.



Example: RRLA

ORDERING INFORMATION

Lead times will vary depending on options selected. Consult with your sales representative.

Series	Wiring instructions	
RRL RELOC®-ready luminaire	A Hot conductor wired to position #1 (phase A); non-dimming B Hot conductor wired to position #2 (phase B); non-dimming AE Hot conductor wired to position #1 (phase A), hot conductor #2 wired to position #2 (phase B); non-dimming C12S Hot conductor in position #1 (phase A), low voltage conductor #1 in position #2,low voltage conductor #2 in position #3; dimming ²	

Compatible RELOC® Cables for Industrial Luminaires (ordered and shipped separately)

(click to view RELOC product page for more information)







- 1 AE commercial fixtures should disconnect the TSPL before unplugging the RRL so it does not go into discharge mode. Requires fixture to have battery option.
- 2 C12S option is used with the OnePass for O-10V/DALI applications. Not for use with dimming sensors.

¹ Cord set required for fixture operation. All cord sets are 18/3, 6' white.